

CSB070000
 JOB NUMBER
 SCALE
 HORIZONTAL: 1"=50'
 VERTICAL: 1"=5'
 4 OF 15 SHEETS
WT04
 SHEET NUMBER
BID DOCUMENT
NOTE
 BEYOND ENGINEERING
 1975 RESEARCH PARKWAY, SUITE 155
 COLORADO SPRINGS, CO 80920
 719.268.8900 TEL. 719.268.9200 FAX
 WWW.NOIOTE.COM



WATER SYSTEM IMPROVEMENTS
TRANSMISSION LINE REPLACEMENT
PLAN & PROFILE STA: 35+00 TO 48+00
 PREPARED FOR: THE VILLAGE OF CIMARRON
 DATE SUBMITTED: JUNE 2008

NO.	REV.	DATE	REVISIONS

CAUTION: The engineer preparing these plans will not be responsible for these plans. All changes to the plans must be in writing and must be approved by the preparer of these plans.

CALL UTILITY NOTIFICATION CENTER AT 1-800-321-ALERT (25378) BEFORE YOU DIG, GRADE, OR EXCAVATE. CALL 2-BUSINESS DAYS IN ADVANCE.

SCALE: 1" = 50'
 NOTICE OF EXTENDED PAYMENT PROVISION - THIS CONTRACT ALLOWS THE OWNER TO MAKE PAYMENT WITHIN 45 DAYS AFTER ACCEPTANCE BY THE VILLAGE OF CIMARRON OF AN UNDISPUTED REQUEST FOR PAYMENT.

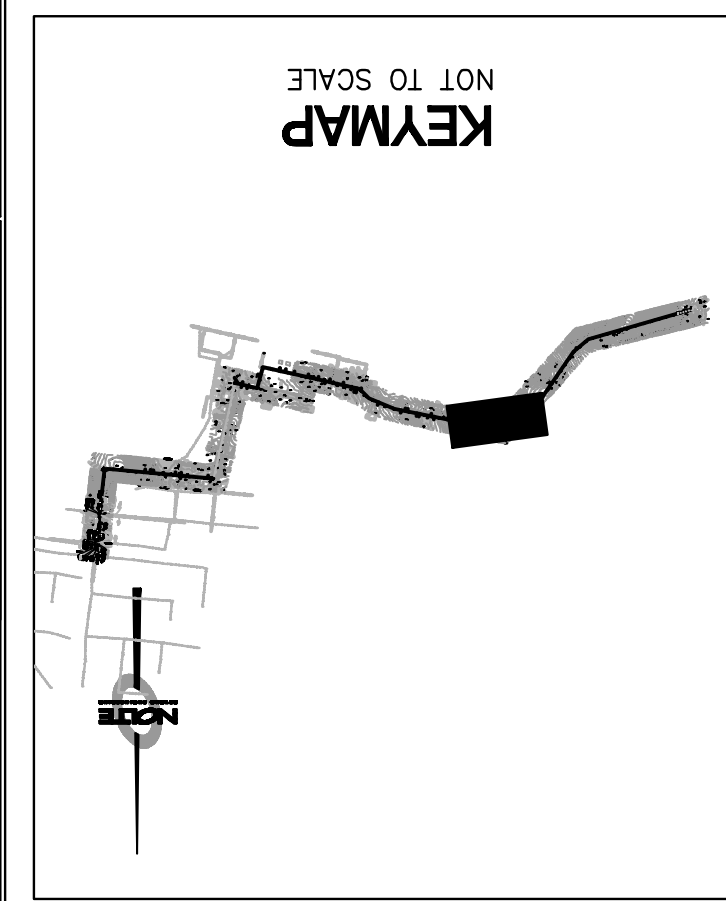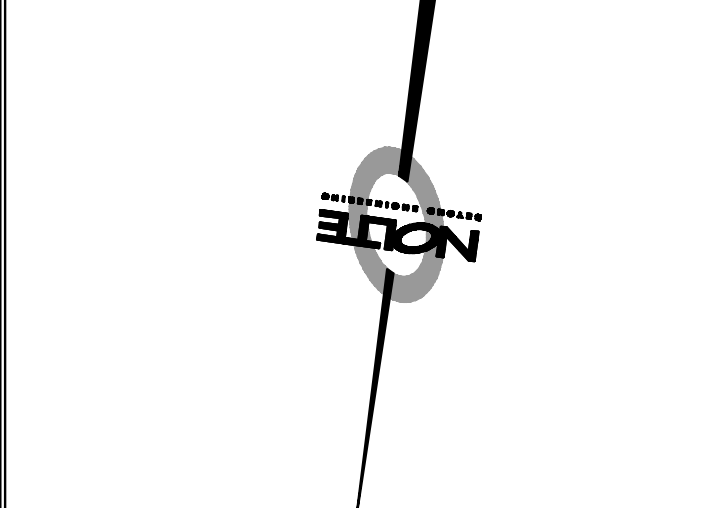

- PROPOSED 6" WATER MAIN
- PROPOSED VALVES
- PROPOSED REDUCER
- PROPOSED WATER MANHOLE
- PROPOSED WATER FITTINGS
- BENDS
- PROPOSED WATER BLOW OFF V.
- PROPOSED WATER AIR/VACUUM RELEASE VALVE
- EXISTING WATER
- EXISTING OVER HEAD ELECTRIC
- EXISTING STORM DRAIN
- EXISTING CULVERT
- EXISTING SANITARY SEWER
- EXISTING WATER VALVES
- EXISTING TREE
- EXISTING GAS METER
- EXISTING GAS MAHOLE

NOTES:
 1. FOR PIPE DEFLECTION ANGLES GREATER THAN THE MANUFACTURER TOLERANCE, CONTRACTOR SHALL USE HIGH DEFLECTION COUPLINGS OR APPROVED EQUAL.
 2. WHEN PROCEEDING WITH NOTE 1 ABOVE, CONTRACTOR SHALL MAINTAIN A MINIMUM DEFLECTION RADIUS OF 300 FT.