
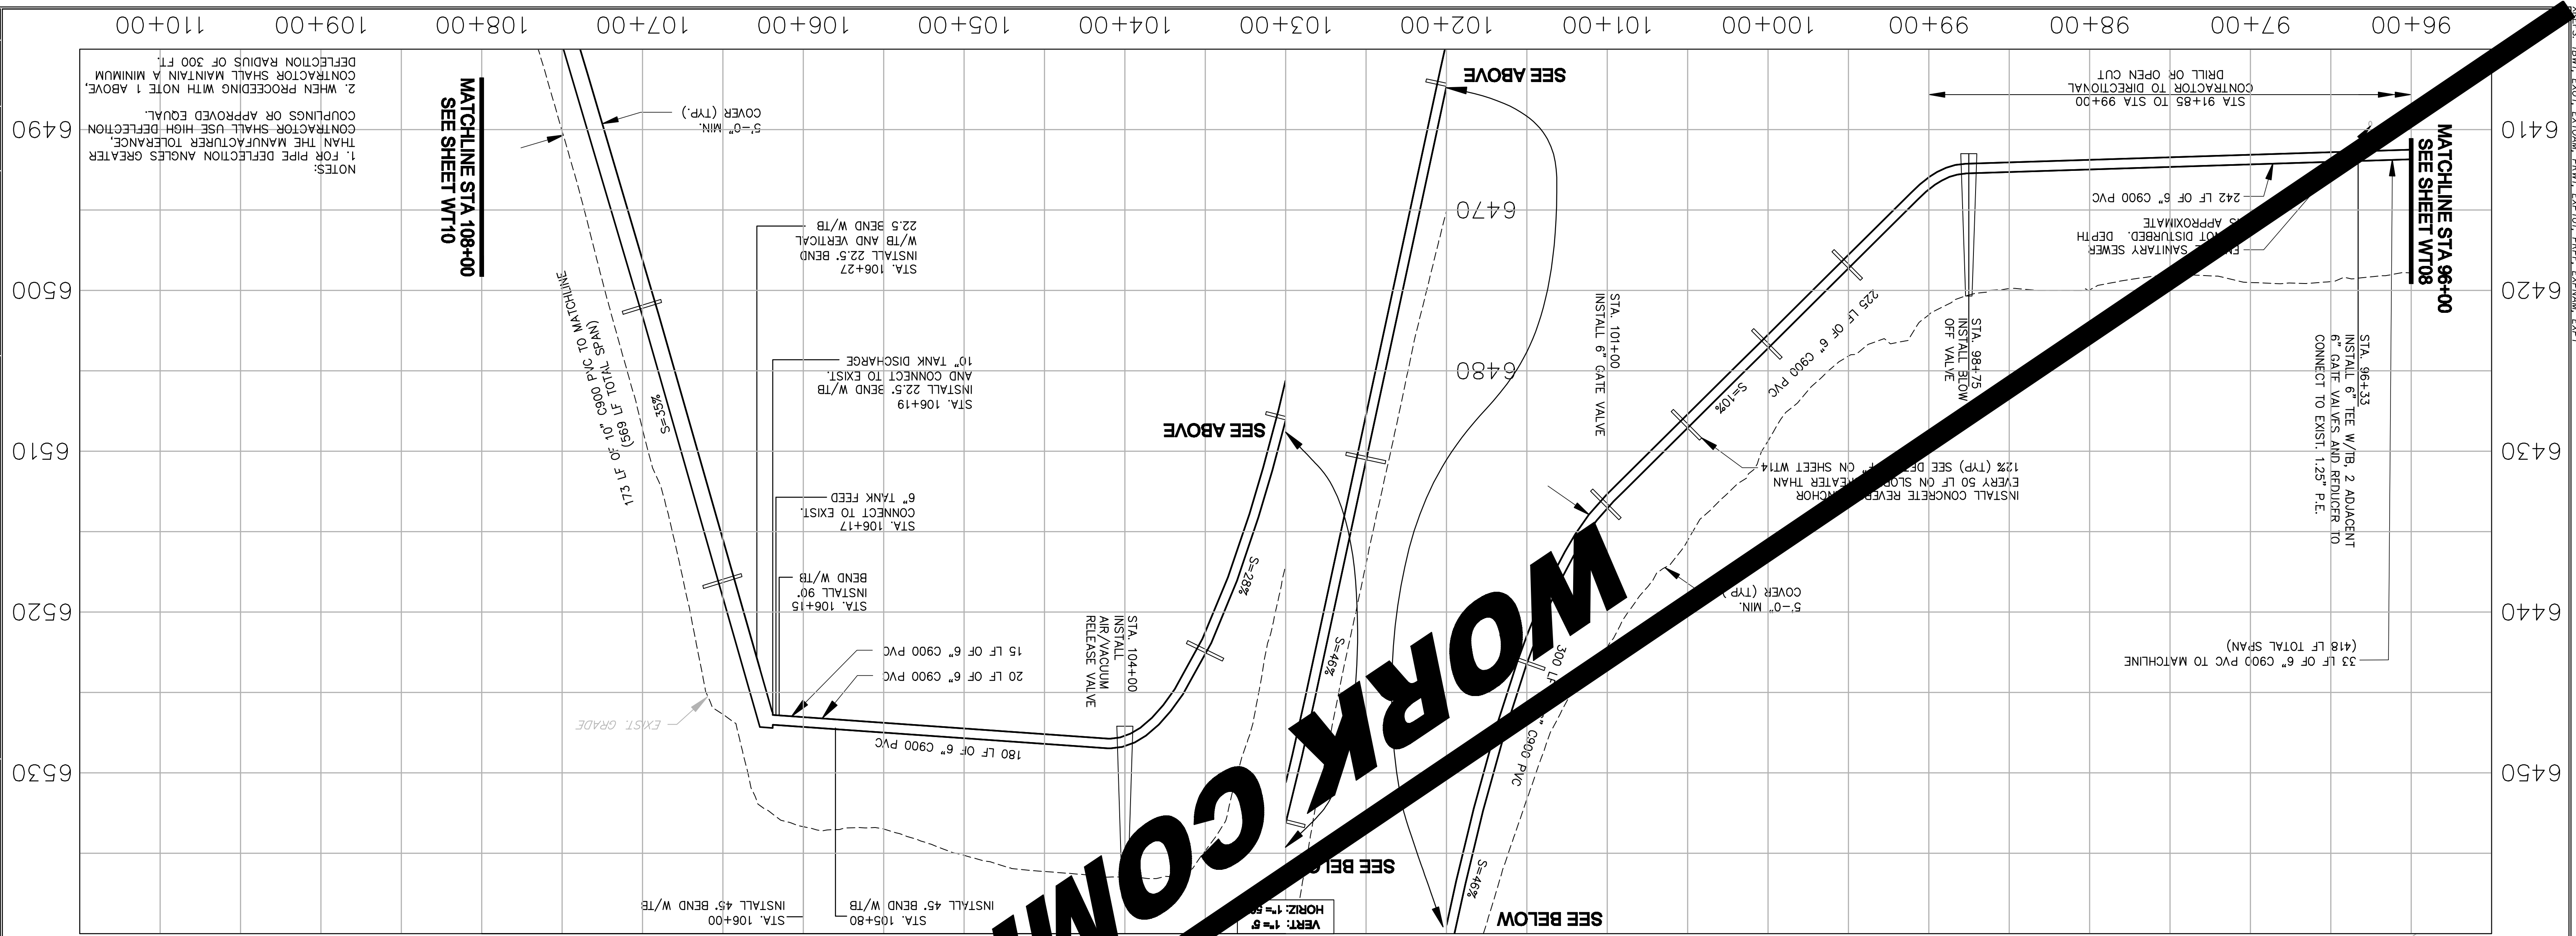


NOTE
 CONTRACTOR SHALL COORDINATE WITH ALL UTILITIES THROUGHOUT PROJECT FOR LOCATING PURPOSES.
 1. CONTRACTOR SHALL POTHOLE AND LOCATE ALL UTILITIES WITHIN ALLEWAY. A DETAILED SKETCH OF THE UTILITIES SHALL BE SUBMITTED TO THE ENGINEER PRIOR TO ANY INSTALLATION OF WATER LINE. CONTRACTOR IS RESPONSIBLE FOR INFORMING THE ENGINEER OF THE NEW PROPOSED WATER LINE ALIGNMENT BASED ON CONTRACTOR FIELD INVESTIGATION PRIOR TO INSTALLATION. FURTHERMORE, CONTRACTOR SHALL BE RESPONSIBLE FOR DAMAGE OF ANY UTILITIES DURING INSTALLATION.

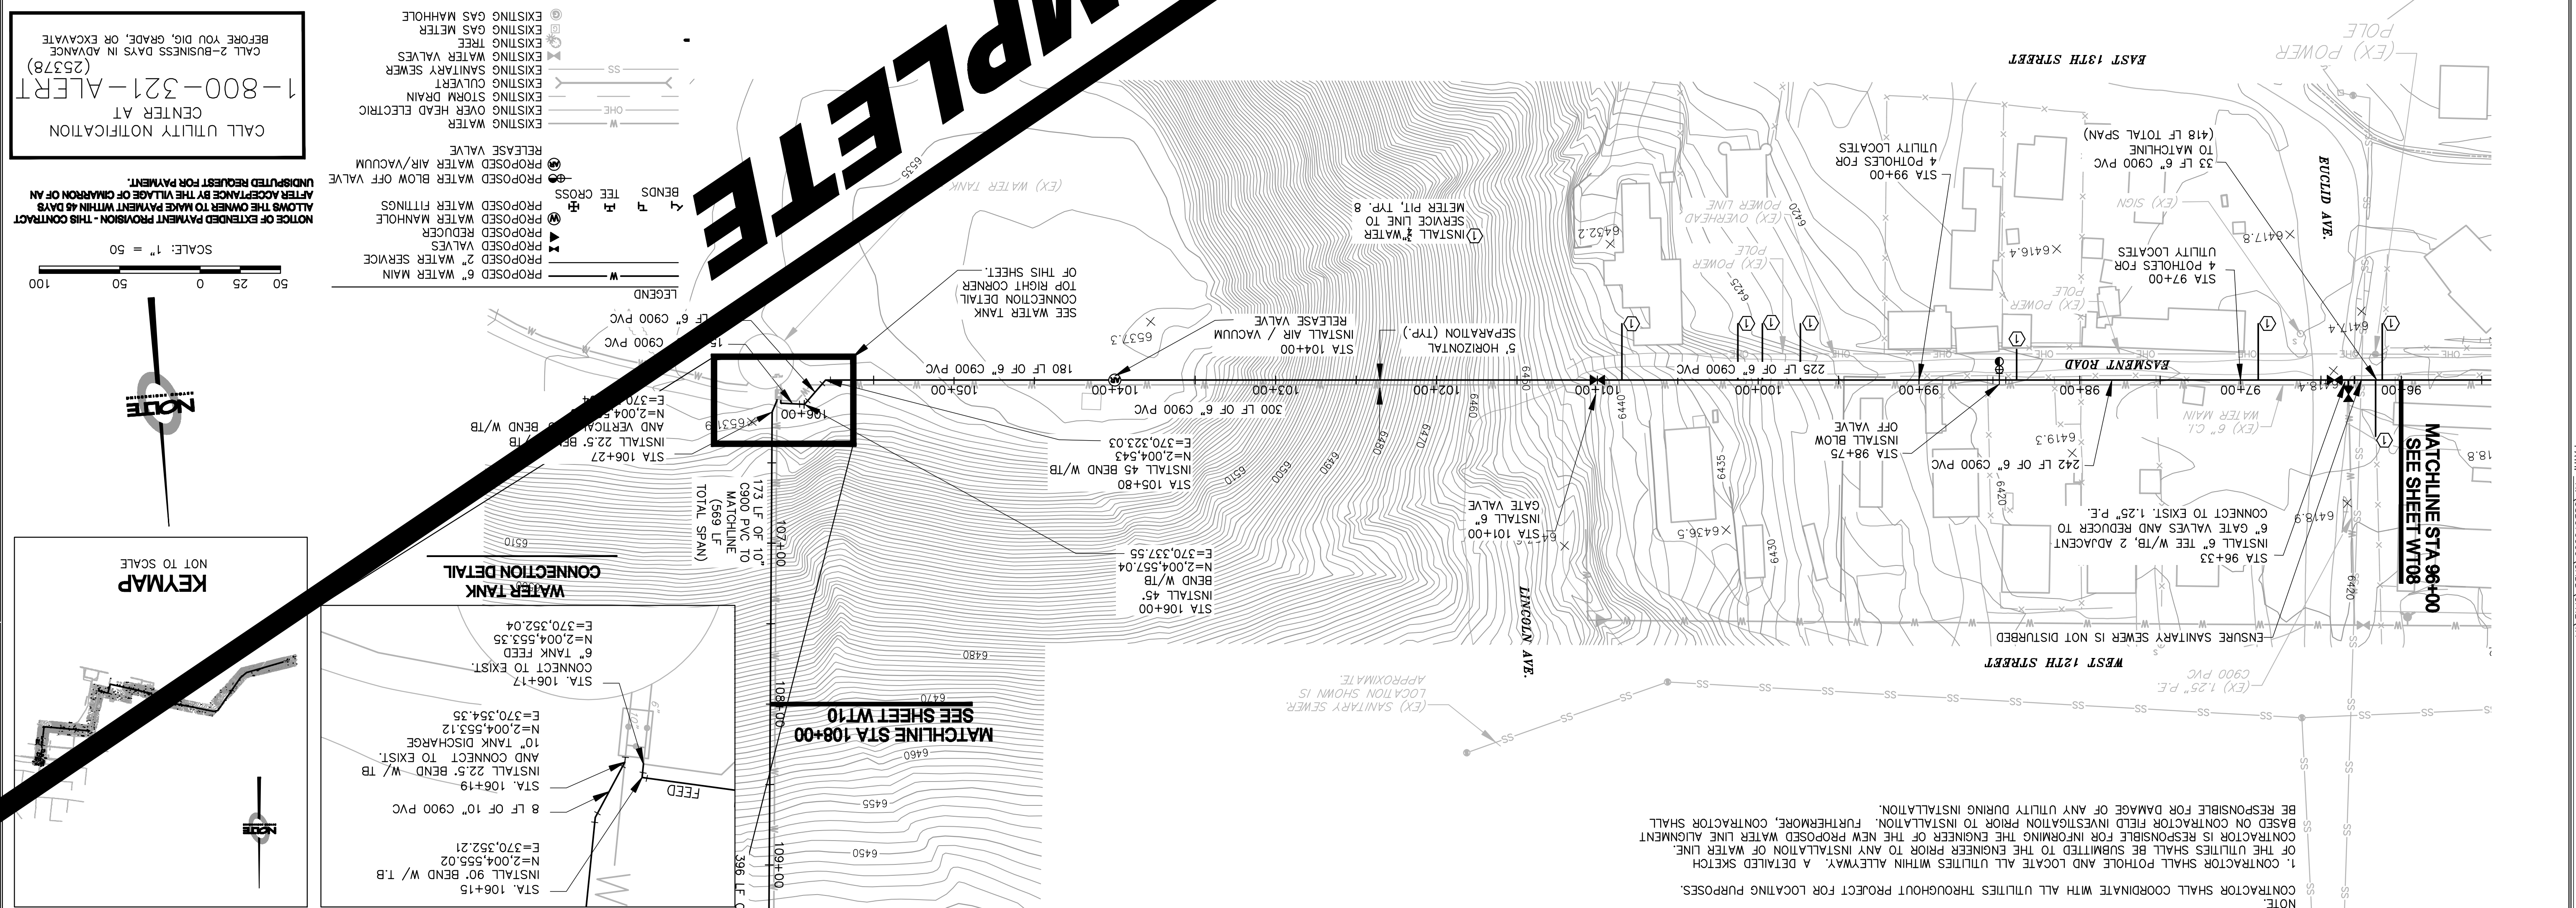

WORK COMPLETE

- LEGEND**
- PROPOSED 6" WATER MAIN
 - PROPOSED 2" WATER SERVICE
 - PROPOSED VALVES
 - PROPOSED REDUCERS
 - PROPOSED WATER MANHOLE
 - PROPOSED WATER FITTINGS
 - AFTER ACCEPTANCE BY THE VILLAGE OF CIMARRON 48 DAYS
 - NOTICE OF EXTENDED PAYMENT PROVISION - THIS CONTRACT
 - UNDISBURSED REQUEST FOR PAYMENT.
 - CALL UTILITY NOTIFICATION CENTER AT 1-800-321-ALERT (25378)
 - BEFORE YOU DIG, GRADE, OR EXCAVATE CALL 2-BUSINESS DAYS IN ADVANCE

CALL UTILITY NOTIFICATION CENTER AT 1-800-321-ALERT (25378)

BEFORE YOU DIG, GRADE, OR EXCAVATE CALL 2-BUSINESS DAYS IN ADVANCE

SCALE: 1" = 50'

100 50 0 25 50



KEYMAP
 NOT TO SCALE

JOB NUMBER CSB070000

SCALE 1"=50'

HORIZONTAL 1"=50'

VERTICAL 1"=50'

SHEETS 15

SHEET NUMBER WT09

DOCUMENT

BEYOND ENGINEERING

1975 RESEARCH PARKWAY, SUITE 165
 719.268.8300 TEL. 719.268.9200 FAX

COLORADO SPRINGS, CO 80920

WWW.NOI.ITE.COM

PREPARED FOR: THE VILLAGE OF CIMARRON

DATE SUBMITTED: JUNE 2008

CAUTION

The engineer preparing these plans will not be responsible for any errors or omissions in these plans. All changes to the plans must be in the form of a written change order and must be approved by the engineer.

NOTES:
 1. FOR PIPE DEFLECTION ANGLES GREATER THAN THE MANUFACTURER TOLERANCE, CONTRACTOR SHALL USE HIGH DEFLECTION COUPLINGS OR APPROVED EQUAL.
 2. WHEN PROCEEDING WITH NOTE 1 ABOVE, CONTRACTOR SHALL MAINTAIN A MINIMUM DEFLECTION RADIUS OF 300 FT.


MATCHLINE STA 108+00
 SEE SHEET WT10

MATCHLINE STA 96+00
 SEE SHEET WT08

MATCHLINE STA 96+00
 SEE SHEET WT08

MATCHLINE STA 108+00
 SEE SHEET WT10

WATER TANK CONNECTION DETAIL

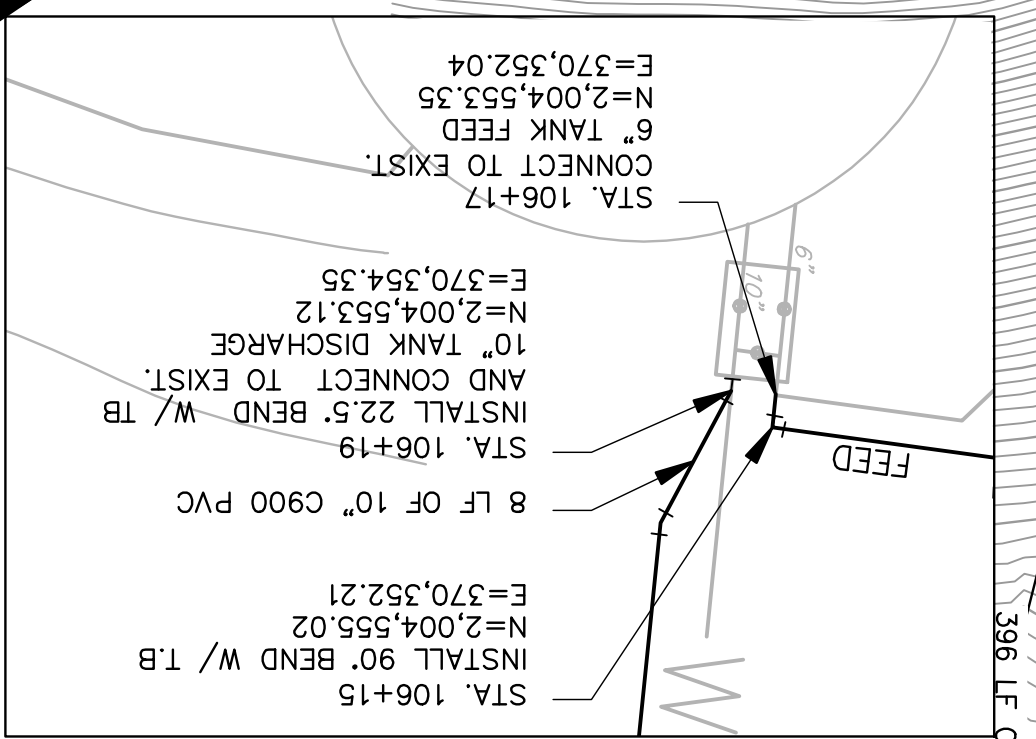

NOTES:
 1. FOR PIPE DEFLECTION ANGLES GREATER THAN THE MANUFACTURER TOLERANCE, CONTRACTOR SHALL USE HIGH DEFLECTION COUPLINGS OR APPROVED EQUAL.
 2. WHEN PROCEEDING WITH NOTE 1 ABOVE, CONTRACTOR SHALL MAINTAIN A MINIMUM DEFLECTION RADIUS OF 300 FT.